

SUBMITTAL DATA SHEET



11EER P-C & P-S

CONDO PACK THRU THE WALL SINGLE PACKAGED VERTICAL UNIT

JOB NAME:	_____	LOCATION:	_____
PURCHASER:	_____	ORDER NO:	_____
ENGINEER:	_____		_____
SUBMITTED TO:	_____	FOR:	_____
		REF:	_____
		APPROVAL:	_____
		CONSTRUCTION:	_____
SUBMITTED BY:	_____	DATE:	_____
UNIT DESIGNATION:	_____		
SCHEDULE NO:	_____	MODEL NO:	Select Model

PRODUCT DATA

COOLING PERFORMANCE

Capacity: _____ BTU/h

EER: _____

Refrigerant: _____

HEATING PERFORMANCE

Input Capacity: _____ BTU/h

Output Capacity: _____ BTU/h

AFUE/TE: _____ %

Air Temp Rise: _____ °F

SUPPLY AIR BLOWER PERFORMANCE

Total Supply Air: _____ CFM

Total External Static Pressure: _____ IWC

Motor Rating: _____ HP

ELECTRICAL DATA

Power Supply: _____

Minimum Circuit Ampacity: _____ A

Maximum Overload

Protective Device: _____ A

UNIT WEIGHT

Unit Shipping Weight: _____ LBS

DIMENSIONS AND CLEARANCES


NOTE

***ENGINEER / ARCHITECT TO CONSULT WITH NAPOLEON ENGINEERING TO DETERMINE BRACKET LOCATION FOR SETTING THE DESIRED DEPTH OF WALL SLEEVE INTO WALL.


CLEARANCES

FRONT	0.25" MIN.
RIGHT SIDE	2" MIN.
LEFT SIDE	0"
BOTTOM	8" from the floor

** A clear and unobstructed passageway (dimension AxB) shall be provided to the unit, in accordance with the requirements of the local authorities having jurisdiction and with the National Fuel Gas Code, ANSI Z223.1 (latest edition) and the National Electrical Code in the United States or CAN/CGA-B149.1 & 2 and the Canadian Electrical Code CSA C22.1 Part 1 (latest edition) in Canada.

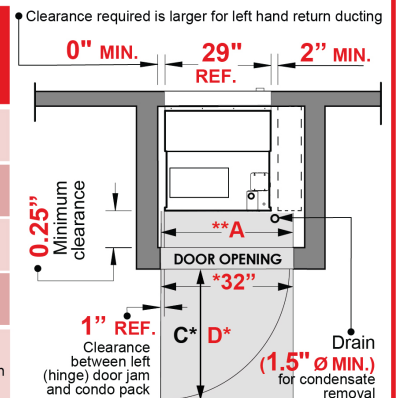

*For A12A & A18A units: The 32" x C (32.5") unobstructed clearance is required in front of the unit for complete removal of heating and cooling module.
*For A24A units: The 32" x D (40") unobstructed clearance is required in front of the unit. Check local building codes for other applicable requirements.

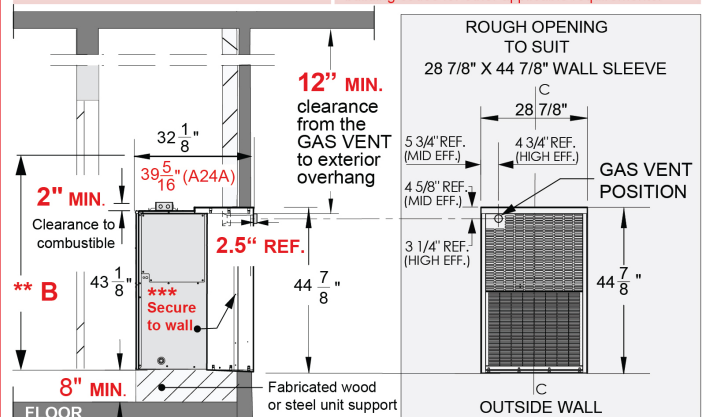

IMPORTANT: Minimum required vertical clearance of a vent terminal and overhanging structure from the top of the gas vent is 12" (more than 12" is recommended). Check local building codes for other requirements.